

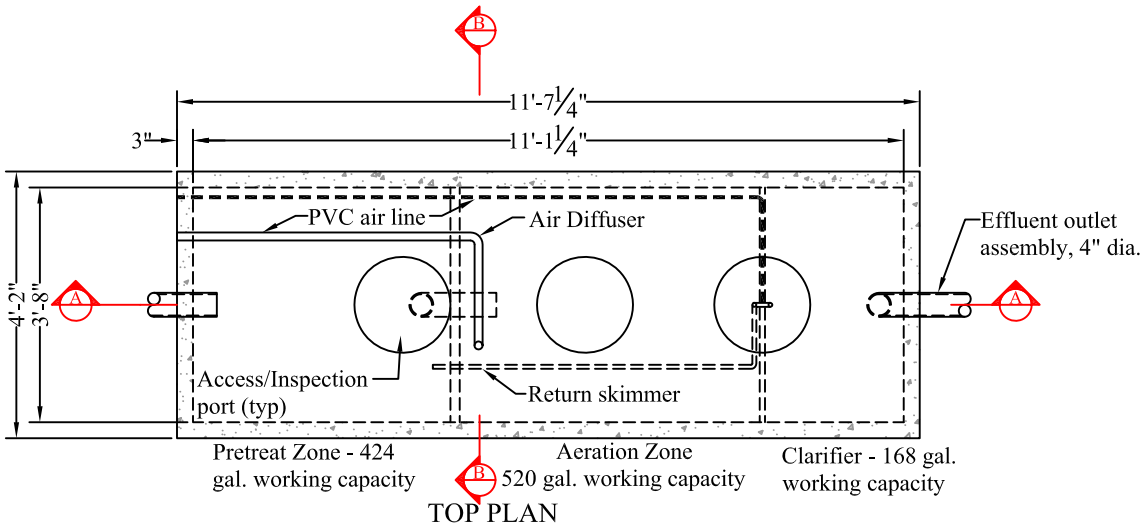


TOP PLAN

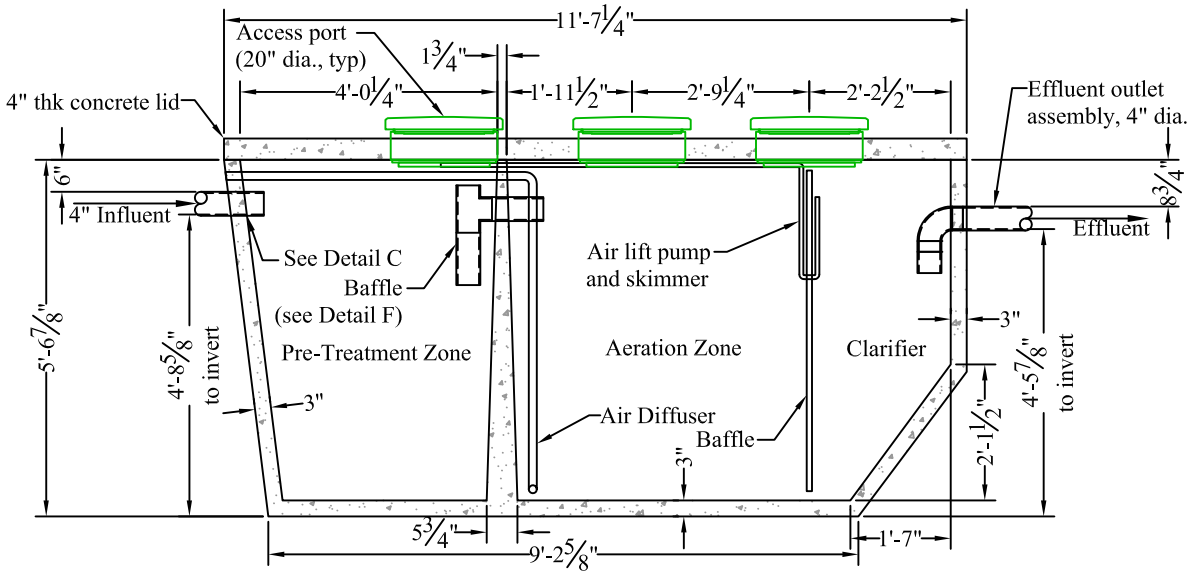

SECTION 'A-A'

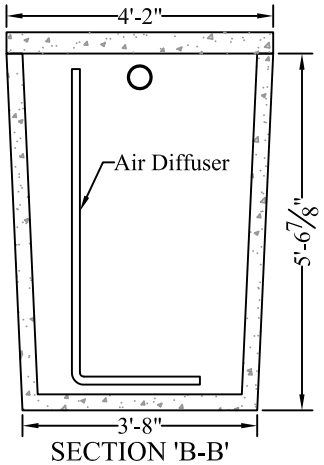


SECTION 'B-B'




Note: Diffuser constructed from
1½" dia, Sch. 40 PVC

DETAIL B - AIR DIFFUSER
n.t.s.



Note: Assembly constructed from 4" dia. Sch. 40 PVC

DETAIL D - EFFLUENT OUTLET
ASSEMBLY
n.t.s.



Note: Baffle constructed from
4" dia, Sch. 40 PVC

DETAIL F - BAFFLE
n.t.s.



DETAIL C - PIPE INSTALLATION
n.t.s.

Notes:
1. All measurements are as indicated.
2. Outside dimensions are determined by tank material.
3. Concrete tanks have 3" thick walls.
4. Max. burial depth is 40" to top of influent pipe.

Scale: 1" = 3'

0 1 2 3 6

AquaKlear of New Jersey
206 Main Street, Andover, N.J. 07821

PROJECT:

AquaKlear Aerobic Treatment Unit
AquaKlear Model Concrete AK6PT

SCALE:	DATE:	DRAWN BY:	CHK'D BY:	DRAWING #:
1" = 3'	April 12, 2019	lvp	dbj	1 of 1

©COPYRIGHT 2019, AQUAKLEAR OF NEW JERSEY, ALL RIGHTS RESERVED.
ANY DUPLICATION WITHOUT THE EXPRESS WRITTEN CONSENT OF AQUAKLEAR OF NEW JERSEY IS STRICTLY PROHIBITED.