

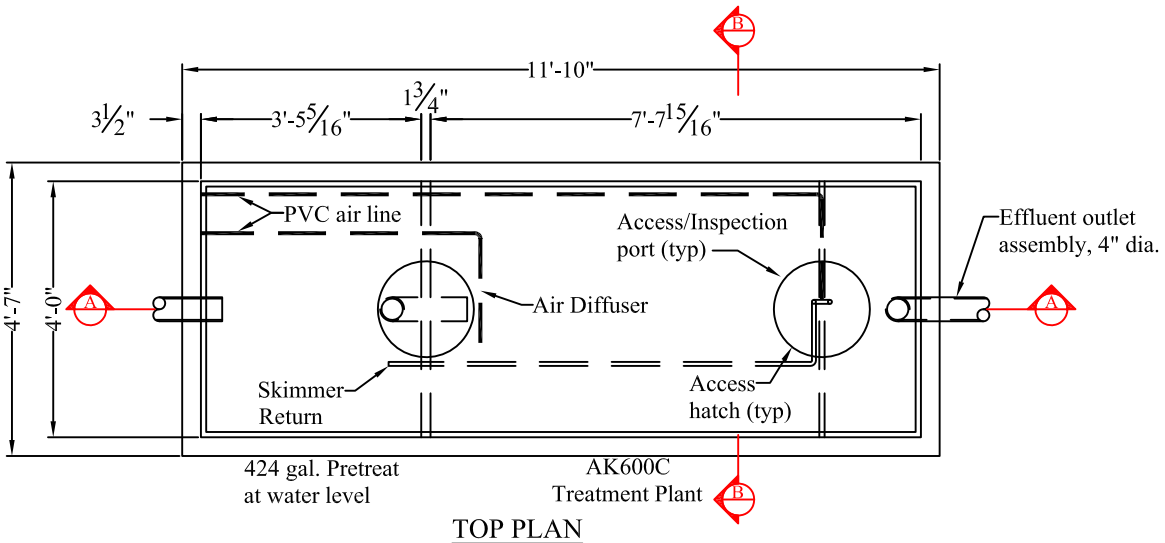


TOP PLAN

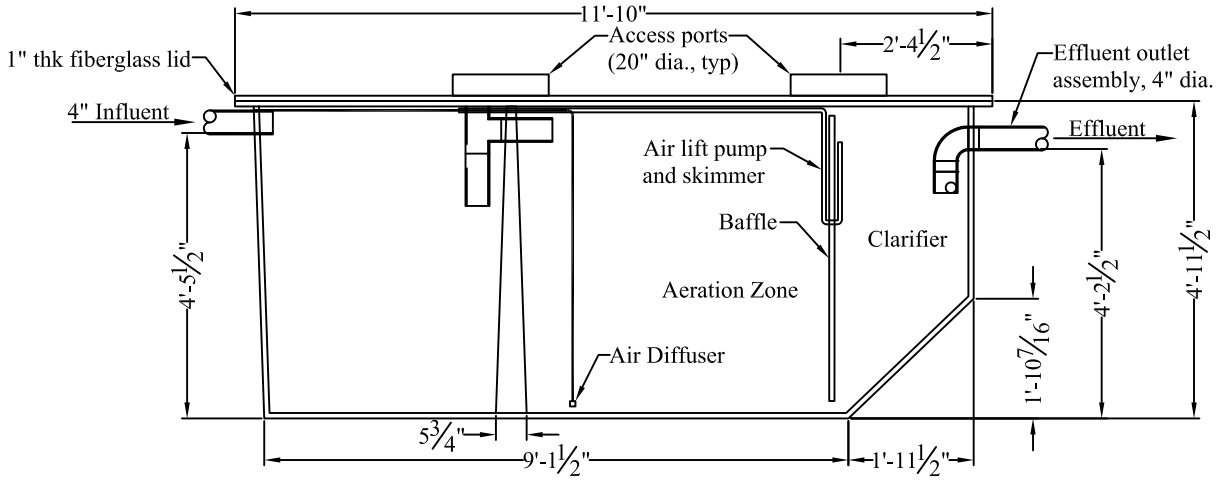

SECTION 'A-A'

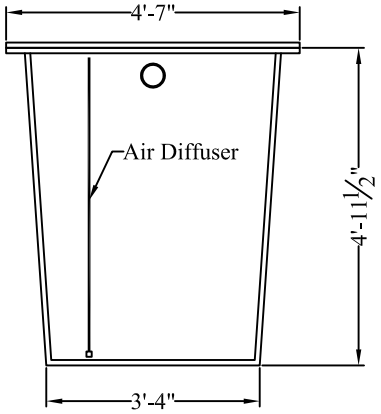


SECTION 'B-B'



Note: Diffuser constructed from 1 ½" dia, Sch. 40 PVC

DETAIL B - AIR DIFFUSER


n.t.s.



Note: Diffuser constructed from 1 ½" dia, Sch. 40 PVC

DETAIL D - EFFLUENT OUTLET ASSEMBLY

n.t.s.



Note: Baffle constructed from 4" dia, Sch. 40 PVC

DETAIL F - BAFFLE

n.t.s.




DETAIL C - PIPE INSTALLATION

n.t.s.

Notes:

1. All measurements are as indicated.
2. Outside dimensions are determined by tank material.
3. Thickness will be indicated on fiberglass drawings.
4. Max. burial depth is 40" to top of influent pipe.

Scale: 1" = 3'



AquaKlear of New Jersey
206 Main Street, Andover, N.J. 07821

PROJECT:

AquaKlear Aerobic Treatment Unit
AquaKlear Model Fiberglass AK6PT

SCALE:	DATE:	DRAWN BY:	CHK'D BY:	DRAWING #:
1" = 3'	July 3, 2019	lvp	dbj	1 of 1

©COPYRIGHT 2019, AQUAKLEAR OF NEW JERSEY, ALL RIGHTS RESERVED.
ANY DUPLICATION WITHOUT THE EXPRESS WRITTEN CONSENT OF AQUAKLEAR OF NEW JERSEY IS STRICTLY PROHIBITED.